
State of Utah **Bacteriological Flow Chart**

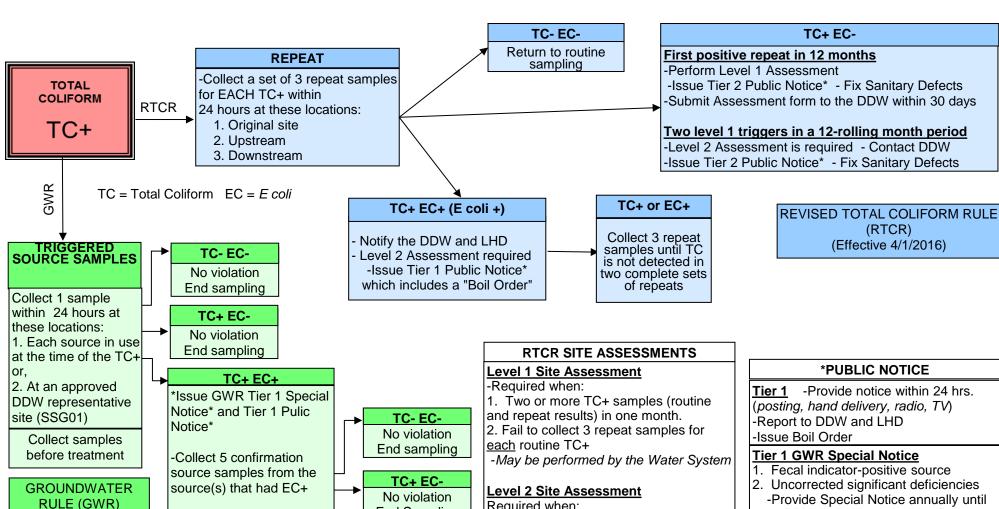

TC+ sample(s) require meeting the requirements of both the GWR and RTCR. Contact DDW: 801-536-4200. Submit reports to: DDWReports @utah.gov See also: www.drinkingwater.utah.gov

TC+ EC+

Perform corrective action

(Effective 12/1/2009)

Required when:

End Sampling

- 1.TC+ routine and EC+ repeat sample
- 2. EC+ routine and TC+ repeat sample
- 3. Fail to collect all 3 required repeats following an EC+ rountine sample.
- 4. Two Level 1 triggers in 12 months -Must be performed by the DDW or DDW approved third party
- -Provide Special Notice annually until DDW determines the significant deficiencies are corrected and the fecal

contamination is addressed.

Tier 2

Provide public notice within 30 days (posting, hand/direct delivery, mail a separate notice or include with a bill